


REVISIONS						
ECN	REV.	DESCRIPTION	DATE	DRAW	CHECK	APPROVED
924	A	Initial Release	2010/02/25	XY	XY	XY
929	B	Update Duct Mount Kit	2010/08/23	XY	XY	XY
966	C	ADD B5	2011/10/05	XY	XY	XY
990	D	REMOVE B5	2012/04/010	XY	XY	XY

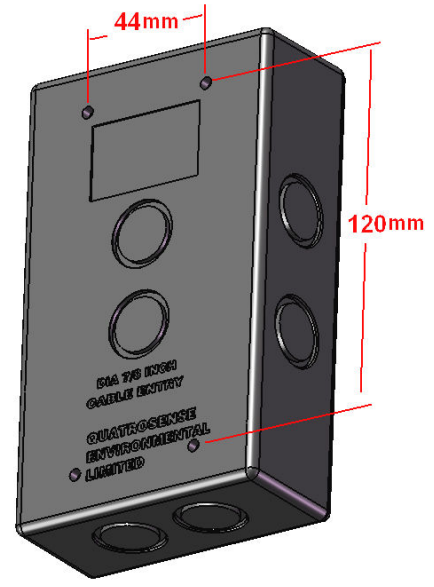

**SPECIFICATION**

**INPUT POWER:**  
 +24VDC nominal, range: 18 to 30VDC 0.3A DC Total Max.  
 ~24VAC nominal, range: 15 to 24VAC 50/60HZ 0.3A AC Total Max.  
 (AC must not be grounded)

**FUSE:**  
 F2 on Main Board: Polyswitch 750mA  
 Polyswitch device resets after the fault is cleared and power to the circuit is removed

**SENSOR:**  
 Combustible gases: Catalytic  
 Toxic gases and Oxygen: Electrochemical  
 Carbon Dioxide: Non-Dispersive Infra-Red (NDIR)

**OUTPUT SIGNAL:**  
 RS-485 with OPTIMUX PROTOCOL AND MODBUS PROTOCOL  
 4-20mA Analog Output, 1-5VDC, 2-10VDC Output  
 3X SPDT RELAYS: 1.0A MAX. @30VDC (RESISTIVE LOAD)  
 0.3A MAX. @125VAC (RESISTIVE LOAD)

**ENCLOSURE:**  
 IP 66 & NEMA 4, 4X, 12 & 13

**OPERATING TEMPERATURE:**  
 -40°C to 70°C, depends on sensor specification

**AMBIENT HUMIDITY:**  
 5% TO 95% RH (NON- CONDENSING)

**STORAGE TEMPERATURE:**  
 0°C to 20°C, depends on sensor specification

**SIZE:** 150mm X 90mm X 65mm


**WEIGHT:** LESS THAN 0.5lbs

**Option Accessories:**

\*Option Accessories are not included in Q5 or B5 Standard Package.




Pump-thru & Cal Cap Kit SKU#: 85930-006-000  
 Splash Guard Kit SKU#: 85930-007-000

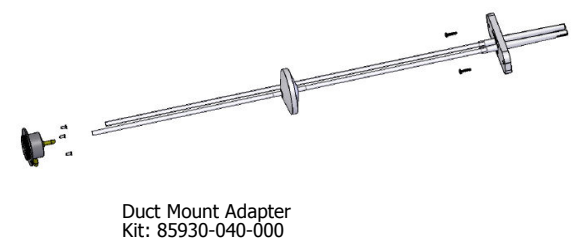

Duct Mount Adapter Kit: 85930-040-000



Q-View & USB-RS485 Converter Kit: 85930-004-000



Free-Stand or Duct Mounted IR-Probe



**PROPRIETARY AND CONFIDENTIAL**  
 THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF Quatrosense Environmental Ltd. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF Quatrosense Environmental Ltd. IS PROHIBITED.

UNLESS OTHERWISE SPECIFIED:		NAME	DATE	Quatrosense Environmental Ltd
DIMENSIONS ARE IN INCHES		DRAWN	2010/02/25	
TOLERANCES:		CHECKED	2010/02/25	
FRACTIONAL: ± 1/32		ENG APPR.	2010/02/25	
ANGULAR:		MFG APPR.		TITLE: <b>Q5</b> <b>INSTALLATION DRAWING</b>
MACH ± .5 degrees BEND ± TWO PLACE DECIMAL ± .02 THREE PLACE DECIMAL ± .010		Q.A.		
INTERPRET GEOMETRIC TOLERANCING PER:		COMMENTS:		SIZE DWG. NO. REV <b>B</b> 85950-002-000 <b>D</b>
MATERIAL				
NEXT ASSY	USED ON			SCALE: 1:8 WEIGHT: SHEET 1 OF 6
APPLICATION		DO NOT SCALE DRAWING		

8 7 6 5 4 3 2 1

REVISIONS				
ZONE	REV.	DESCRIPTION	DATE	APPROVED
-	-	See Sheet1	-	-

### Power and RS-485 Connection for Q5:

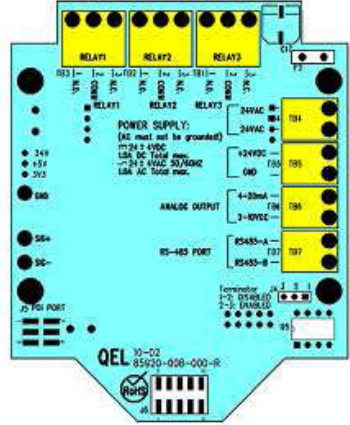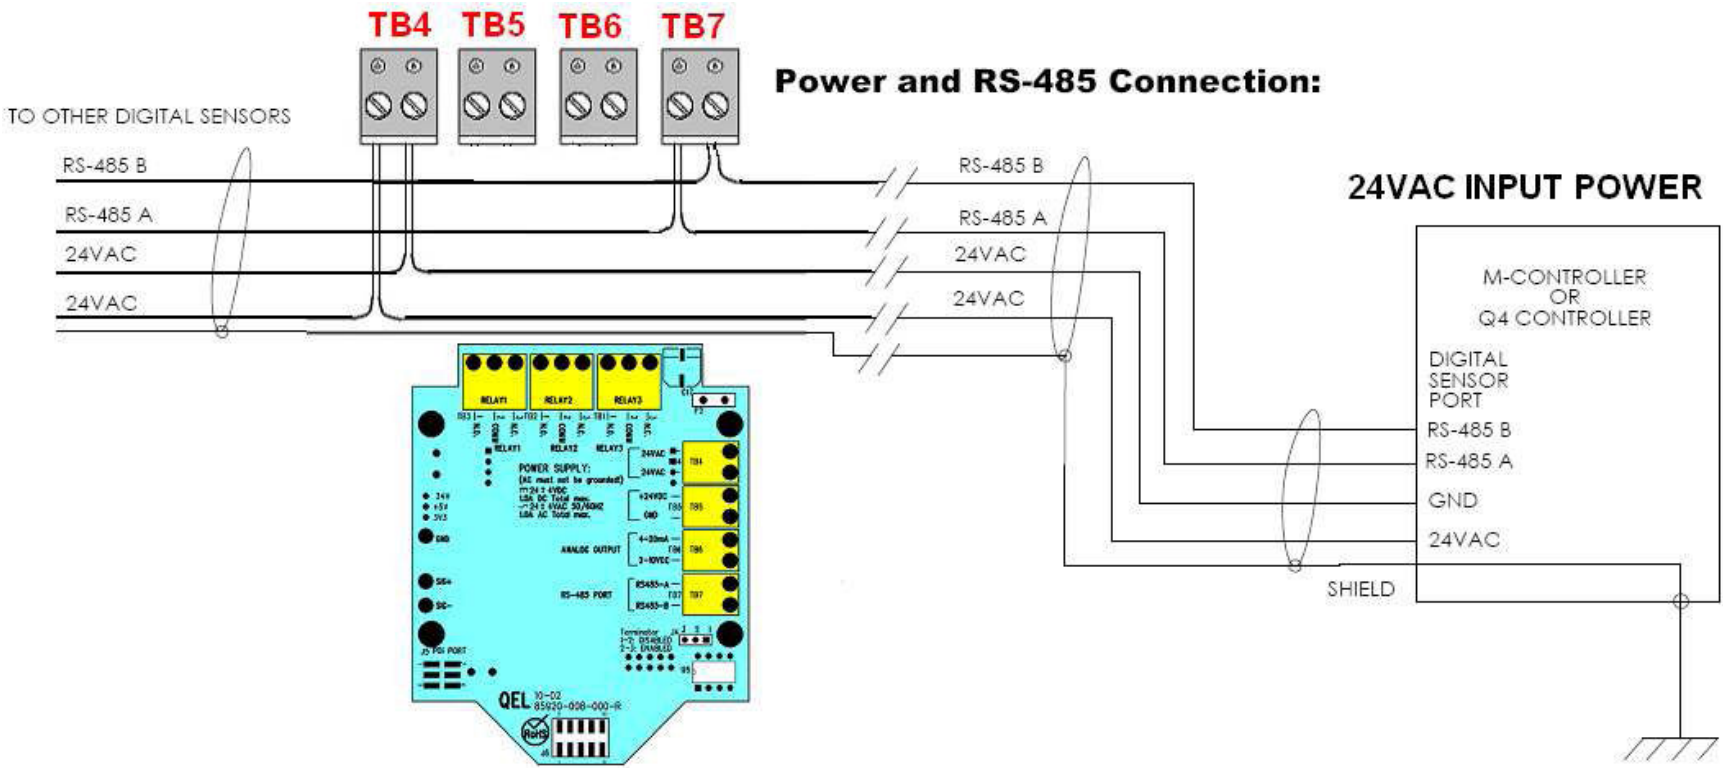

Q5 MAIN BOARD

- NOTE:
- GROUND THE SHIELD IN CONTROLLER SIDE
  - GROUND ON ONE END ONLY

**PROPRIETARY AND CONFIDENTIAL**  
 THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF <INSERT COMPANY NAME HERE>. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF <INSERT COMPANY NAME HERE> IS PROHIBITED.

		UNLESS OTHERWISE SPECIFIED:		NAME		DATE		Quatrosense Environmental Ltd	
		DIMENSIONS ARE IN INCHES		DRAWN		XY		2010/02/25	
		TOLERANCES:		CHECKED		XY		2010/02/25	
		FRACTIONAL: ±		ENG APPR.		XY		2010/02/25	
		ANGULAR: MACH ± BEND ±		MFG APPR.					
		TWO PLACE DECIMAL ±		Q.A.					
		THREE PLACE DECIMAL ±		COMMENTS:					
		INTERPRET GEOMETRIC TOLERANCING PER:							
		MATERIAL							
		FINISH							
NEXT ASSY		USED ON							
APPLICATION		DO NOT SCALE DRAWING							
				TITLE:		Q5		INSTALLATION DRAWING	
				SIZE		DWG. NO.		REV	
				B		85950-002-000		D	
				SCALE: 1:2				SHEET 2 OF 6	


8 7 6 5 4 3 2 1

8 7 6 5 4 3 2 1

REVISIONS				
ZONE	REV.	DESCRIPTION	DATE	APPROVED
-	-	See Sheet1	-	-

**Power and RS-485 Connection for Q5:**

Q5 MAIN BOARD

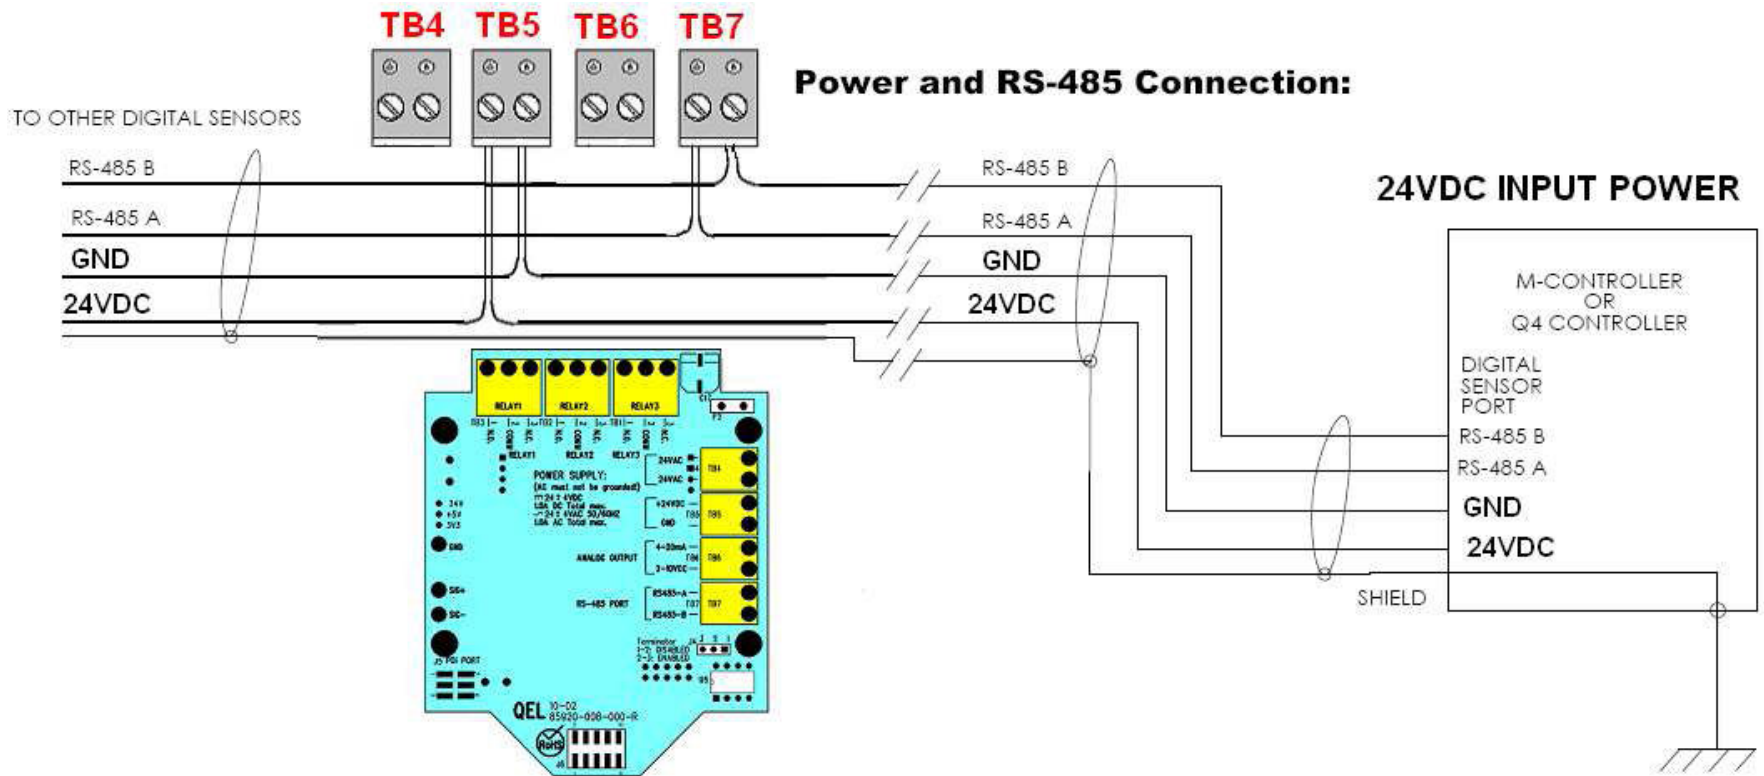

D  
C  
B  
A

D  
C  
B  
A

- NOTE:  
 1. GROUND THE SHIELD IN CONTROLLER SIDE  
 2. GROUND ON ONE END ONLY




**PROPRIETARY AND CONFIDENTIAL**  
 THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF <INSERT COMPANY NAME HERE>. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF <INSERT COMPANY NAME HERE> IS PROHIBITED.

		UNLESS OTHERWISE SPECIFIED:	NAME	DATE	Quatrosense Environmental Ltd TITLE: Q5 Installation Drawing SIZE <b>B</b> DWG. NO. 85950-002-000 REV <b>D</b> SCALE: 1:2 WEIGHT: SHEET 3 OF 6
		DIMENSIONS ARE IN INCHES	DRAWN	XY 2010/02/25	
		TOLERANCES: FRACTIONAL ±	CHECKED	XY 2010/02/25	
		ANGULAR: MACH ± BEND ±	ENG APPR.	XY 2010/02/25	
		TWO PLACE DECIMAL ±	MFG APPR.		
		THREE PLACE DECIMAL ±	Q.A.	XY 2010/02/25	
		INTERPRET GEOMETRIC TOLERANCING PER:	COMMENTS:		
		MATERIAL			
		FINISH			
NEXT ASSY	USED ON				
APPLICATION		DO NOT SCALE DRAWING			

8 7 6 5 4 3 2 1

# 4-20mA and VDC Output for Q5:

REVISIONS				
ZONE	REV.	DESCRIPTION	DATE	APPROVED
-	-	See Sheet1	-	-

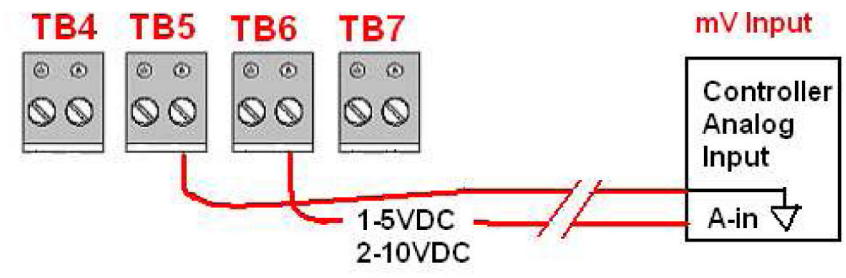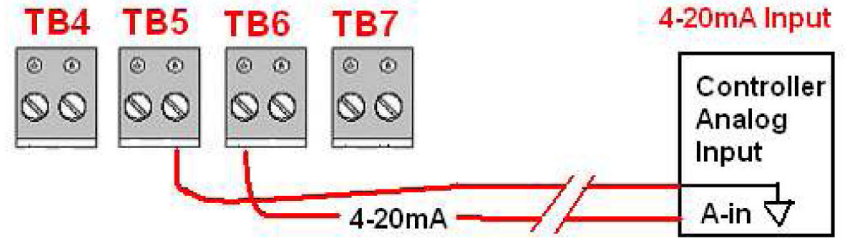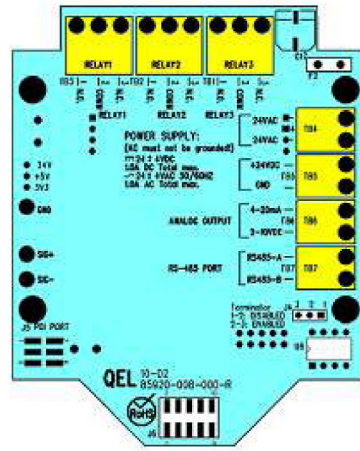


Q5 provides one channel 4-20 milliamp analog output and 1-5VDC or 2-10VDC analog output . The maximum output impedance is 600 ohms for 4-20mA output. The maximum current is 10 mA for VDC output.

Test point SIG+ and SIG- are used to measure the current online when the Q5 is working in the field.

**PROPRIETARY AND CONFIDENTIAL**  
 THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF <INSERT COMPANY NAME HERE>. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF <INSERT COMPANY NAME HERE> IS PROHIBITED.

UNLESS OTHERWISE SPECIFIED:		NAME	DATE	Quatrosense Environmental Ltd TITLE: <b>Q5</b> <b>INSTALLATION DRAWING</b>
DIMENSIONS ARE IN INCHES		XY	2010/02/25	
TOLERANCES:		XY	2010/02/25	
FRACTIONAL: ±		XY	2010/02/25	
ANGULAR: MACH ± BEND ±				
TWO PLACE DECIMAL ±				Q.A.
THREE PLACE DECIMAL ±				COMMENTS:
INTERPRET GEOMETRIC TOLERANCING PER:				
MATERIAL				
FINISH				
NEXT ASSY	USED ON			
APPLICATION		DO NOT SCALE DRAWING		
SIZE	DWG. NO.	REV		
<b>B</b>	85950-002-000	D		
SCALE: 1:2		SHEET 4 OF 6		

REVISIONS				
ZONE	REV.	DESCRIPTION	DATE	APPROVED
-	-	See Sheet1	-	-

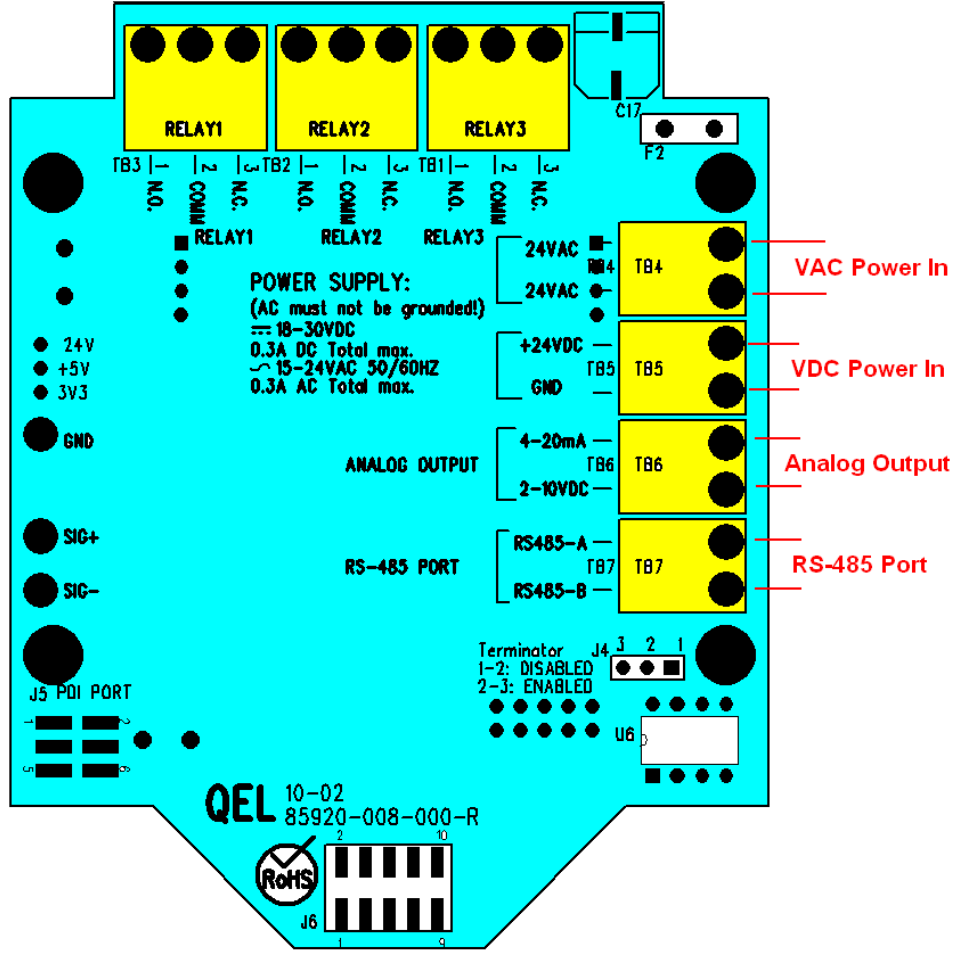

**Twisted Pair?**

RS-485 is designed to be a balanced system. The signal on one wire is ideally the exact opposite of the signal on the second wire. In other words, if one wire is transmitting a high, the other wire will be transmitting a low, and vice versa. Although RS-485 can be successfully transmitted using multiple types of media, it should be used with wiring commonly called "twisted pair."

**Terminator Enable/Disable?**

The terminator on each end of the RS485 loop is designed to match the electrical impedance characteristic of the twisted pair loop, and will prevent signal echoes from corrupting the data on the line. The terminator should be enabled on BOTH ends of the RS485 loop. Short and medium length modbus/485 loops can operate without the terminating resistor. Longer runs may require the terminating resistors. But adding terminator dramatically increases power consumption.

**Sensor Location:**

- Several factors should be considered when selecting locations to install sensors. The following general suggestions should be considered to assure the detection of the target gas. Select the most suitable location for each sensor.
1. Air Currents: If there are fans, winds, or others sources of air movement, gases may tend to rise to collect in certain areas of a facility. The local air currents should be assessed to aid in selecting the sensor location. In outdoor situations considerations such as prevailing winds should be accounted for. Air convection can often be more important in determining gas concentrated areas than factors of Vapor Density.
  2. Vapor Density: For the target gas heavier than air. Detecting location should be 9 - 18 inch (0.23m to 0.46m) above the floor.
  3. Gas Emission Sources: As a rule, at least one sensor should be located in close proximity to each point where a leak is likely to occur. This is particularly important when a liquid having a low volatility is monitored.
  4. Environmental Factors: Designed to rugged outdoor use consider the following in selecting locations. Install sensors where they will be protected from wind, dust, snow, water, vibration and shock.

**Note:**

- Avoid running communication wires or sensor input wires next to AC power wires or the relay output wires. These can be sources of noise that can affect signal quality.
- When the Q5 input power is AC, the 24VAC must not be grounded. A dedicated floating 24VAC may be needed if other nodes on the network are grounded, otherwise DC power supply is recommended.

**PROPRIETARY AND CONFIDENTIAL**  
 THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF <INSERT COMPANY NAME HERE>. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF <INSERT COMPANY NAME HERE> IS PROHIBITED.

		UNLESS OTHERWISE SPECIFIED:		NAME		DATE		Quatrosense Environmental Ltd	
		DIMENSIONS ARE IN INCHES		DRAWN	XY	2012/02/13		TITLE: <b>Q5</b> <b>INSTALLATION DRAWING</b>	
		TOLERANCES:		CHECKED	XY	2012/02/13			
		FRACTIONAL ±		ENG APPR.	XY	2012/02/13			
		ANGULAR: MACH ± BEND ±		MFG APPR.					
		TWO PLACE DECIMAL ±		Q.A.				SIZE DWG. NO. REV	
		THREE PLACE DECIMAL ±		COMMENTS:				B 85950-002-000 D	
		INTERPRET GEOMETRIC TOLERANCING PER:						SCALE: 1:2 SHEET 5 OF 6	
		MATERIAL							
		FINISH							
NEXT ASSY		USED ON							
		APPLICATION							
		DO NOT SCALE DRAWING							



8 7 6 5 4 3 2 1

D

C

B

A

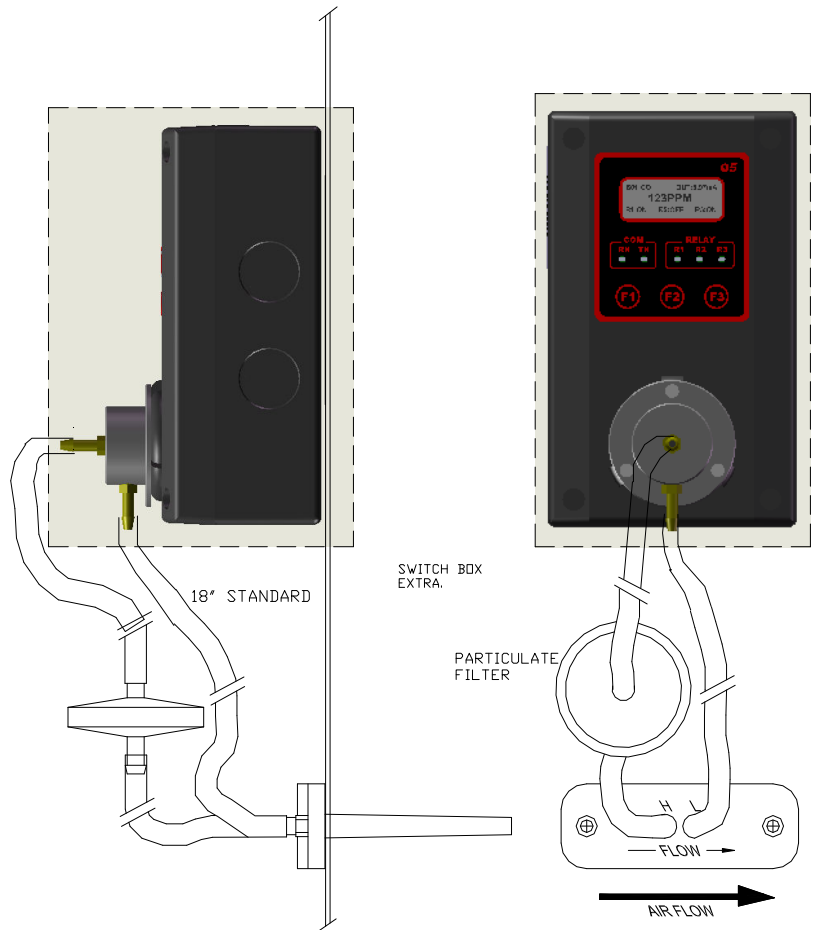

NOTE: GAS SAMPLING OCCURS WHEN AIR FLOW ACROSS THE THE TWO TUBES CAUSES DIFFERENTIAL PRESSURE. THIS METHOD WILL NOT WORK IN STATIC AIR SAMPLING.

DUCT MOUNTING OPTION

**PROPRIETARY AND CONFIDENTIAL**  
 THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF <INSERT COMPANY NAME HERE>. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF <INSERT COMPANY NAME HERE> IS PROHIBITED.

		UNLESS OTHERWISE SPECIFIED:		NAME	DATE	<b>Quatrosense Environmental Ltd</b>  TITLE: <p style="text-align: center;">Q5</p> <b>INSTALLATION DRAWING</b>	
		DIMENSIONS ARE IN INCHES		DRAWN	XY		2012/02/13
		TOLERANCES:		CHECKED	XY		2012/02/13
		FRACTIONAL: ±		ENG APPR.	XY		2012/02/13
		ANGULAR: MACH ± BEND ±		MFG APPR.			
		TWO PLACE DECIMAL ±		Q.A.	XY	2012/02/13	
		THREE PLACE DECIMAL ±		COMMENTS:			
		INTERPRET GEOMETRIC TOLERANCING PER:					
		MATERIAL					
		FINISH					
NEXT ASSY	USED ON					SIZE <b>B</b> DWG. NO. <b>85950-002-000</b> REV <b>D</b>	
APPLICATION		DO NOT SCALE DRAWING				SCALE: 1:2 WEIGHT: SHEET 6 OF 6	

8 7 6 5 4 3 2 1